

Power Defender 165/225/270


Variable Speed Pumps

Pool Controller Installation Guide

Power Defender 165/225/270 Variable Speed Pumps can be connected to the **Waterway OASIS Pool Controller** via quick and direct communication through a RS-485 cord. This provides full control with respect to schedule and speed of the variable speed pump (see page 13 of the OASIS manual). Or it can be connected to other brands of pool controller such as Jandy, Pentair, and more... utilizing auxiliary relays to operate up to 4 different speeds as shown below. For further information, see page 24 of the Waterway Variable Speed Motor Manual.

INP #1	1350 RPM
INP #2	1725 RPM
INP #3	2760 RPM
INP #4	3450 RPM

System Level Control Wiring Diagram

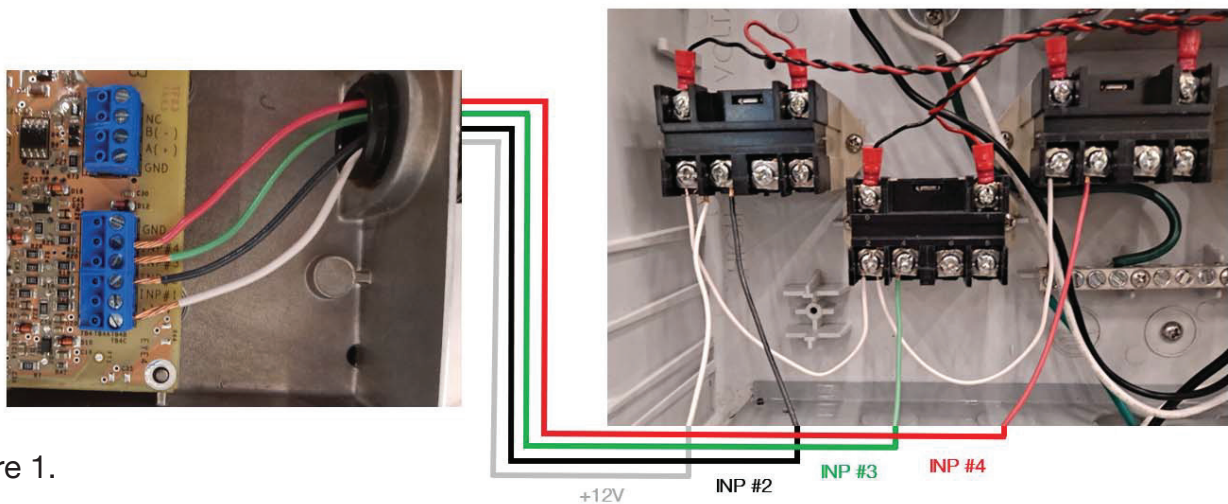

2200 East Sturgis Road, Oxnard CA 93030 • Phone 805.981.0262 • Fax 805.981.9403

www.waterwayplastics.com • waterway@waterwayplastics.com

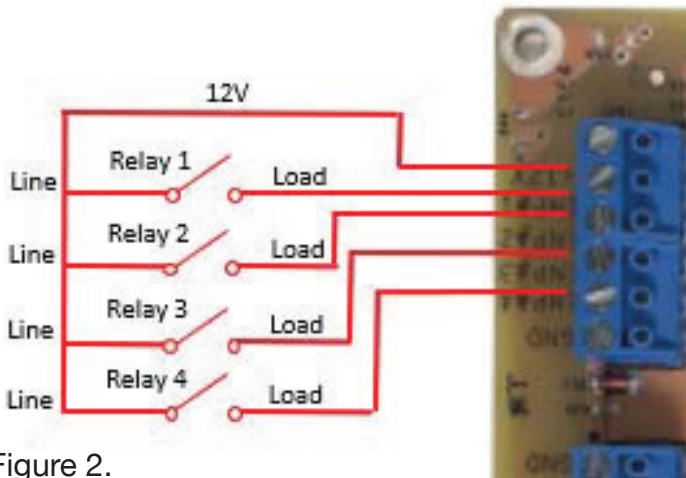


Figure 2.

! WARNING

Access to these terminals is in close proximity to the main connectors which carry line voltage capable of causing personal injury or damaging the equipment if contact is made. Power should be turned off when accessing this area.

NOTE: The controller is rated to accept digital input from the onboard +12V terminal.

In order to use Digital Inputs:

1. Connect the +12V from the pump to the desired input through a relay on a controller.
2. When the relay is closed and 12V is provided to an input connection, the pump will run that corresponding speed.

NOTE: A generic wiring diagram is provided in Figure 1 for connecting the Power Defender 165/225/270 to a “System Level Controller”. The concept can be applied to a solar system or another type of control system.

NOTE: There is no schedule for digital inputs. The timing for each speed is controlled directly by the digital inputs.

NOTE: The digital inputs have the highest priority among all the inputs (i.e. keypad, serial or digital.) Therefore the serial commands as well as the User Interface inputs will be ignored when a digital input is present.


NOTE: If more than one digital input (switch) is present the Power Defender 165/225/270 will give priority to the highest number digital input. Therefore INP# 4 has the highest priority followed by INP# 3, then INP# 2, then INP# 1.

NOTE: If no digital input is detected, the Power Defender 165/225/270 will automatically start the schedule if the START key was pressed prior to the application of a digital input.

System Controllers – ProLogic

Wiring Diagram for ProLogic with Power Defender 165/225/270

- Similar to the AquaLink
 - 12V from the RS485 can be wired to the LINE IN of each AUX.
- LOAD OUT will be the input for each digital signal.

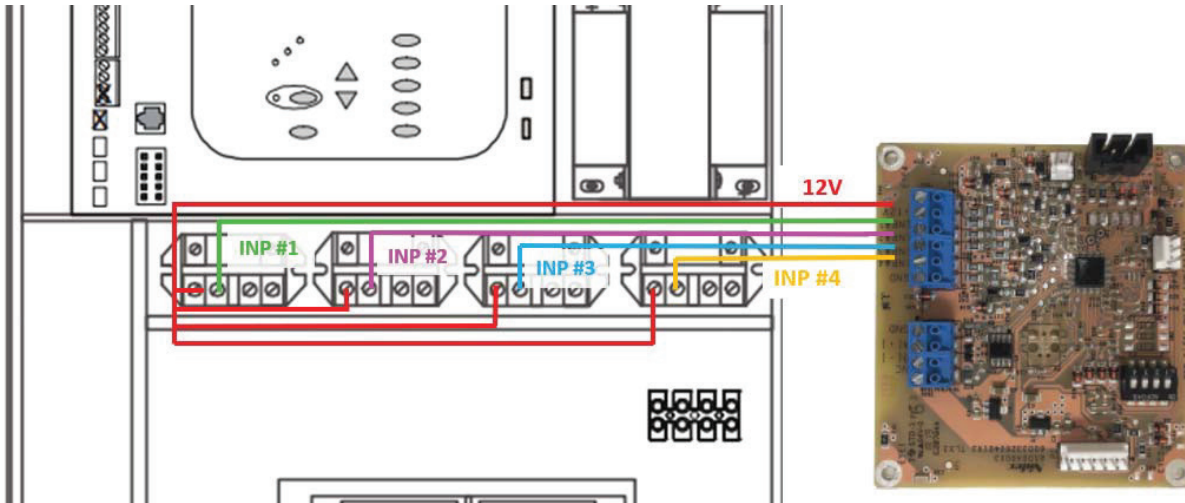


Typical example of wiring. Actual wiring may vary depending on controller manufacturer design and schematics. Installer must verify proper wiring with manufacturer of system controller. Waterway does not assume responsibility for any miswiring.

System Controllers – Multiwave

Wiring Diagram for Multiwave with Power Defender 165/225/270

Select Breaker to match wire size and load requirement. Observe maximum control circuit capacity.

Make sure voltage selector switch is in 120V position before applying power to Terminals 1 & 2.

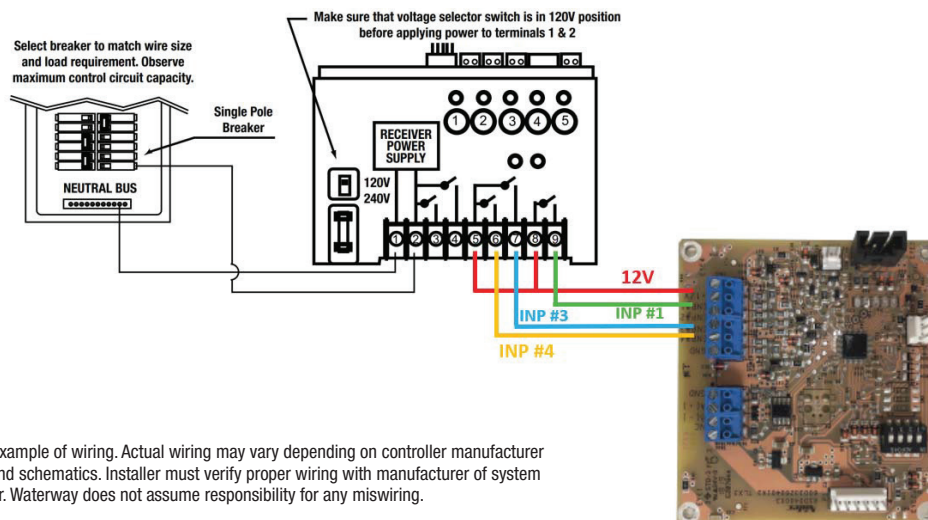

Typical example of wiring. Actual wiring may vary depending on controller manufacturer design and schematics. Installer must verify proper wiring with manufacturer of system controller. Waterway does not assume responsibility for any miswiring.

WARRANTY

For product registration visit: www.waterwayplastics.com.

For Warranty questions or claims please contact point of purchase.